7, Autogennaya Str., Kharkov, 61099, Ukraine. Phone: (+38-057) 728-1244, 728-1241. Fax: (+38-057) 728-1243, (+38-0572) 946-830
E-mail: market@yuzhcable.com.ua

106702-300030000150

# ПвЕгПу(к)-30 3х150
# ТУ У 31.3-00214534-017-2003

Three core power cables with copper conductors, XLPE-insulated, core-filled with bundles, with reinforced outer sheath of polyethylene

Technical cable requirements correspond to IEC 60502-2

Cables are used for laying:
- *in soil (trenches)*
- *on difficult route sections, according to the unique specification*
- *in the air, including cable structures, if provided the additional fire protection*

It is possible to manufacture cables with extruded semiconductor layer along outer sheath.
Order entry example:
ПвЕгПу(к)-П–30 3х150/25 ТУ У 31.3-00214534-017-2003
An extruded semiconductor layer along outer sheath ensures the correct testing of cable line with sections of underground laying in polymer pipes.

It is possible to manufacture cables with an integrated fiber-optic module.
Order entry example:
ПвЕгПу(к)-30 3х150/25 (ОМ) ТУ У 31.3-00214534-017-2003
In conjunction with the DTS system, the integrated fiber-optic module can act as a distributed cable line temperature sensor.

It is possible to manufacture cable with sealed conductors.
Order entry example:
ПвЕгПу(к)-30 3х150/25 (г) ТУ У 31.3-00214534-017-2003

© 2024 PJSC Yuzhcable Works. © 2024 A. Kevorkyan

7, Autogennaya Str., Kharkov, 61099, Ukraine. Phone: (+38-057) 728-1244, 728-1241. Fax: (+38-057) 728-1243, (+38-0572) 946-830
E-mail: market@yuzhcable.com.ua

106702-300030000150

# ПвЕгПу(к)-30 3х150
# ТУ У 31.3-00214534-017-2003

Three core power cables with copper conductors, XLPE-insulated, core-filled with bundles, with reinforced outer sheath of polyethylene

## TECHNICAL SPECIFICATIONS

| | | |
|---|---|---|
| Rated voltage | kV | 30 |
| Maximum voltage | kV | 36 |
| Number and rated area of conductors | $mm^2$ | 3 x 150 |
| Insulation thikness | mm | 8 |
| Minimum screen cross-section | $mm^2$ | 25 |
| Permissible short circuit current across the screen of minimum cross-section | kA | 5.1 |
| Maximum permissible short-circuit current in core | kA | 21.5 |
| Permissible continious current rating * | | |
| • *by aerial laying* | A | 309 |
| • *by burial* | A | 260 |
| Partial discharge factor for rated voltage, not more than | pC | 6 |
| Maximum permissible conductor temperature | | |
| • *Continious* | ° C | +90 |
| • *in emergency operation* | ° C | +130 |
| • *at short circuit* | ° C | +250 |
| Operating temperature range | ° C | -60 ... +50 |
| Minimum bending radius by laying | mm | 1360 |
| Rated outer diameter of the cable (for reference) ** | mm | 85 |
| Cable weight (approximate) | kg/km | 8950 |
| Rated factory cable length and gross weight of the delivery on the drums *** | m, t | # 25УД-90: 420 • 5.3<br># 26УД-100: 604 • 7.2<br># 30УД-130: **** 798 • 10.0 |

*Notes:*

*When ordering it is neccesary to agree the factory length of the product with the manufacturer*

** Long permissible current loads are calculated for the following conditions: conductor temperature 90 °C, air temperature 30 °C, soil temperature 20 °C, load factor 1.0, thermal resistivity of soil 1.5 °K•m/W, laying depth in the ground 0.8 m, shields are grounded at both ends of the line*

*** The external diameter may differ from the rated up to ± 10 %*

**** Отклонение фактической массы брутто от указанного значения может составлять ± 7 %*

***** Option delivery on not full drum*

© 2024 PJSC Yuzhcable Works. © 2024 A. Kevorkyan

YUZHCABLE
PRODUCTION GUIDE

106702-300030000150

7, Autogennaya Str., Kharkov, 61099, Ukraine. Phone: (+38-057) 728-1244, 728-1241. Fax: (+38-057) 728-1243, (+38-0572) 946-830
E-mail: market@yuzhcable.com.ua

# ПвЕгПу(к)-30 3х150
# ТУ У 31.3-00214534-017-2003

Three core power cables with copper conductors, XLPE-insulated, core-filled with bundles, with reinforced outer sheath of polyethylene

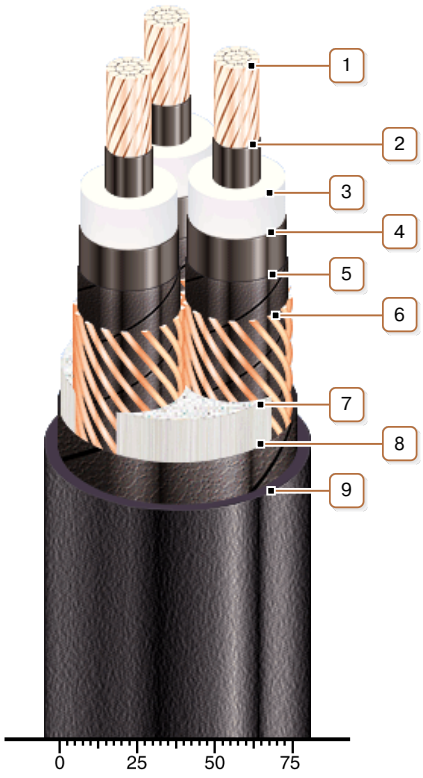


## CONSTRUCTION

*1. Copper multiwire compact conductor*
*Note: It is possible to manufacture cable with sealed conductors.*
*2. Inner extruded semiconducting layer*
*3. XLPE insulation*
*4. Outer extruded semiconducting layer*
*5. Lapping layer of semiconductive swellable tape*
*6. Copper screen*
*7. Interstitial filler with polypropylene bundles*
*8. Lapping layer of semiconductive tape*
*9. Strengthened polyethylene outer sheath*
*Note: It is possible to manufacture cable with extruded semiconductor layer along outer sheath*

*Note: Conductor twisting is not illustrated*

© 2024 PJSC Yuzhcable Works. © 2024 A. Kevorkyan