**АСБВШнг 3х240-1**  
**ТУ У 27.3-00214534-091:2017**

Power cables with aluminium conductors, with impregnated paper insulation, lead-sheathed, steel-tape armoured, with low-flammable PVC-compound protection hose

Cables are used for laying:

- *in dry premises (tunnels), ducts, cable cellars, mines, collectors, industrial and other premises, including damp, partially flooded premises, environment with medium and high corrosiveness*
- *in fire-risk premises*
- *on special cable bridges*
- *with a risk of mechanical damage and no tensile forces in operation*
- *in bunches*

Fire safety code in accordance with ДСТУ 4809:2007: ПБ120000000

Products of this mark meet the requirements:

- *single wire cable flame retardance*
- *bunched cable flame retardance category A*

**TECHNICAL SPECIFICATIONS**

Rated voltage	kV	1
Number and rated area of conductors	mm <sup>2</sup>	3 x 240
Insulation thickness between conductors	mm	1.9
Insulation thickness of conductor-sheath	mm	1.55
Sheath thickness	mm	1.66
Permissible continious current rating *		
• <i>by aerial laying</i>	A	402
• <i>by burial</i>	A	359
Operating temperature range	°C	-50 ... +50
Minimum bending radius by laying	mm	885
Level difference along the laying rout, not more than	m	25
Metal shaeth outer diameter (for reference only)	mm	43
Rated outer diameter of the cable (for reference) **	mm	59
Cable weight (approximate)	kg/km	6810
Rated factory cable length and gross weight of the delivery on the drums ***	m, t	# 18: 320 • 2.6 # 20: 510 • 4.1 # 22: 580 • 4.8

Notes:

*When ordering it is neccesary to agree the factory length of the product with the manufacturer*


*\* Long permissible current loads are calculated for the following conditions: air temperature plus 25 °C, soil temperature plus 15 °C, thermal resistivity of soil 1.2 °K·m/W, laying depth in the soil 0.7 m*

*\*\* The external diameter may differ from the rated up to ± 10 %*



## АСБвШнг 3х240-1 ТУ У 27.3-00214534-091:2017

Power cables with aluminium conductors, with impregnated paper insulation, lead-sheathed, steel-tape armoured, with low-flammable PVC-compound protection hose

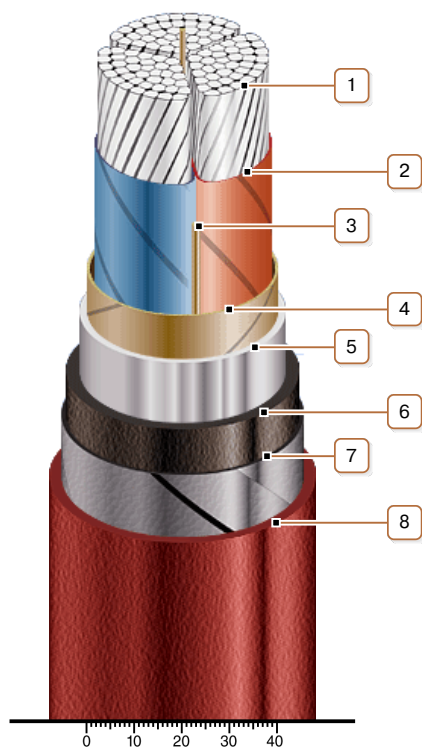

### CONSTRUCTION

1. Aluminium multiwire compacted conductor
2. Impregnated paper insulation
3. Cable paper bundle
4. Belt insulation
5. Lead sheath
6. Bedding with PVC compound moulded-in hose
7. Double galvanized steel-tape armour
8. Pressed off low-flammable PVC compound protection hose

*Note: Conductor twisting is not illustrated*