



7, Autogennaya Str., Kharkov, 61099, Ukraine. Phone: (+38-057) 728-1244, 728-1241. Fax: (+38-057) 728-1243, (+38-0572) 946-830 E-mail: market@yuzhcable.com.ua

# ВВГ 4x2.5-1 ГОСТ 16442-80,ТУ У 31.3-00214534-048:2007

Power cables with copper conductors, with  $\ensuremath{\mathsf{PVC}}\xspace$  compound insulation, with  $\ensuremath{\mathsf{PVC}}\xspace$  compound outer sheath

Cables are used for laying:

- single laying
- in premises, dry ducts and tunnels, in corrosive environment

Manufacturing of cable with PVC compound belt insulation is possible

Fire safety code in accordance with **ДСТУ** 4809:2007: ПБ100000000

Products of this mark meet the requirements:

• single wire cable flame retardance

### **TECHNICAL SPECIFICATIONS**

Rated voltage	kV	1
Number and rated area of conductors	mm²	4 x 2.5
Phase insulation thikness	mm	0.8
Permissible continious current rating (AC of industrial frequency)	*	
• by aerial laying	А	25
• by burial	А	33
Maximum permissible conductor temperature		
Continious	°C	+70
in emergency operation	°C	+90
at short circuit	°C	+160
Operating temperature range	°C	-50 +50
Minimum bending radius by laying	mm	97.5
Rated outer diameter of the cable (for reference) **	mm	13
Cable weight (approximate)	kg/km	190
Rated factory cable length and gross weight of the delivery	m, t	# 10: 1410 · 0.3
on the drums ***		

Notes:

When ordering it is neccesary to agree the factory length of the product with the manufacturer

\* Long permissible current loads are calculated during operation in four-wire networks with load in all the conductors for the following conditions: air temperature plus 25 °C, soil temperature plus 15 °C, thermal resistivity of soil 1.2 °K • m/W, laying depth in the soil 0.7 m \*\* The external diameter may differ from the rated up to  $\pm$  10 %






7, Autogennaya Str., Kharkov, 61099, Ukraine. Phone: (+38-057) 728-1244, 728-1241. Fax: (+38-057) 728-1243, (+38-0572) 946-830 E-mail: market@yuzhcable.com.ua



# ВВГ 4x2.5-1 ГОСТ 16442-80,ТУ У 31.3-00214534-048:2007

Power cables with copper conductors, with  $\ensuremath{\mathsf{PVC}}\xspace$  compound insulation, with  $\ensuremath{\mathsf{PVC}}\xspace$  compound outer sheath

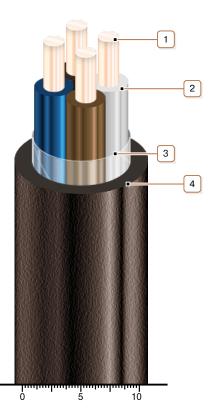

## CONSTRUCTION

- 1. Copper conductor
- 2. PVC compound insulation
- 3. PET film winding
- 4. PVC compound outer sheath

Note: Conductor twisting is not illustrated