



7, Autogennaya Str., Kharkov, 61099, Ukraine. Phone: (+38-057) 728-1244, 728-1241. Fax: (+38-057) 728-1243, (+38-0572) 946-830 E-mail: market@yuzhcable.com.ua



ВВГ 5х6-1 ГОСТ 16442-80,ТУ У 31.3-00214534-048:2007

Power cables with copper conductors, with PVC-compound insulation, with PVC-compound outer sheath

Cables are used for laying:

- single laying
- in premises, dry ducts and tunnels, in corrosive environment

Manufacturing of cable with PVC compound belt insulation is possible

Fire safety code in accordance with ДСТУ 4809:2007: ПБ100000000

Products of this mark meet the requirements:

• single wire cable flame retardance

TECHNICAL SPECIFICATIONS

| Rated voltage | kV | 1 |
|--|-------|------------------|
| Number and rated area of conductors | mm² | 5 x 6 |
| Phase insulation thikness | mm | 1 |
| Permissible continious current rating (AC of industrial frequency) | * | |
| • by aerial laying | А | 42 |
| • by burial | А | 54 |
| Maximum permissible conductor temperature | | |
| Continious | °C | +70 |
| in emergency operation | °C | +90 |
| at short circuit | °C | +160 |
| Operating temperature range | °C | -50 +50 |
| Minimum bending radius by laying | mm | 127.5 |
| Rated outer diameter of the cable (for reference) ** | mm | 17 |
| Cable weight (approximate) | kg/km | 440 |
| Rated factory cable length and gross weight of the delivery | m, t | # 12: 1130 · 0.6 |
| on the drums *** | | |
| | | |

Notes:

When ordering it is neccesary to agree the factory length of the product with the manufacturer

* Long permissible current loads are calculated for the following conditions: air temperature plus 25 °C, soil temperature plus 15 °C,

thermal resistivity of soil 1.2 $\% \cdot m/W$, laying depth in the soil 0.7 m

 ** The external diameter may differ from the rated up to \pm 10 %






7, Autogennaya Str., Kharkov, 61099, Ukraine. Phone: (+38-057) 728-1244, 728-1241. Fax: (+38-057) 728-1243, (+38-0572) 946-830 E-mail: market@yuzhcable.com.ua



ВВГ 5х6-1 ГОСТ 16442-80,ТУ У 31.3-00214534-048:2007

Power cables with copper conductors, with $\ensuremath{\mathsf{PVC}}\xspace$ compound insulation, with $\ensuremath{\mathsf{PVC}}\xspace$ compound outer sheath

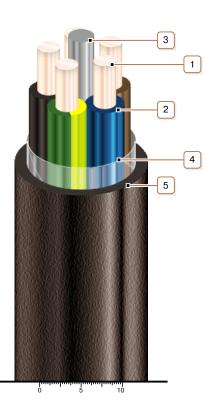

CONSTRUCTION

- 1. Copper conductor
- 2. PVC compound insulation
- 3. PVC compound bundle
- 4. PET film winding
- 5. PVC compound outer sheath

Note: Conductor twisting is not illustrated